

189

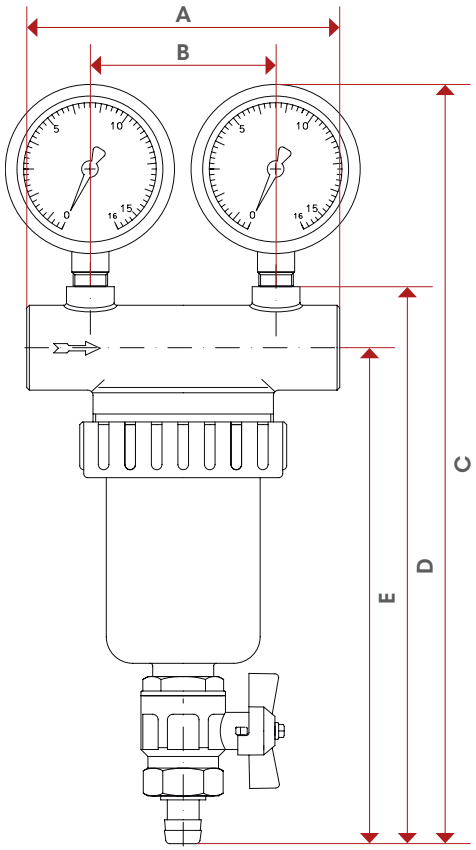

	1/2"	3/4"	1"	1"1/4	1"1/2	2"
A	118	118	123	123	153	153
B	70	70	72	72	98	98
C	272	272	302	302	342	342
D	208	208	234	234	272	272
E	187	187	202	202	236	236
Kg/cm² bar	16	16	16	16	16	16
LBS - psi	232	232	232	232	232	232

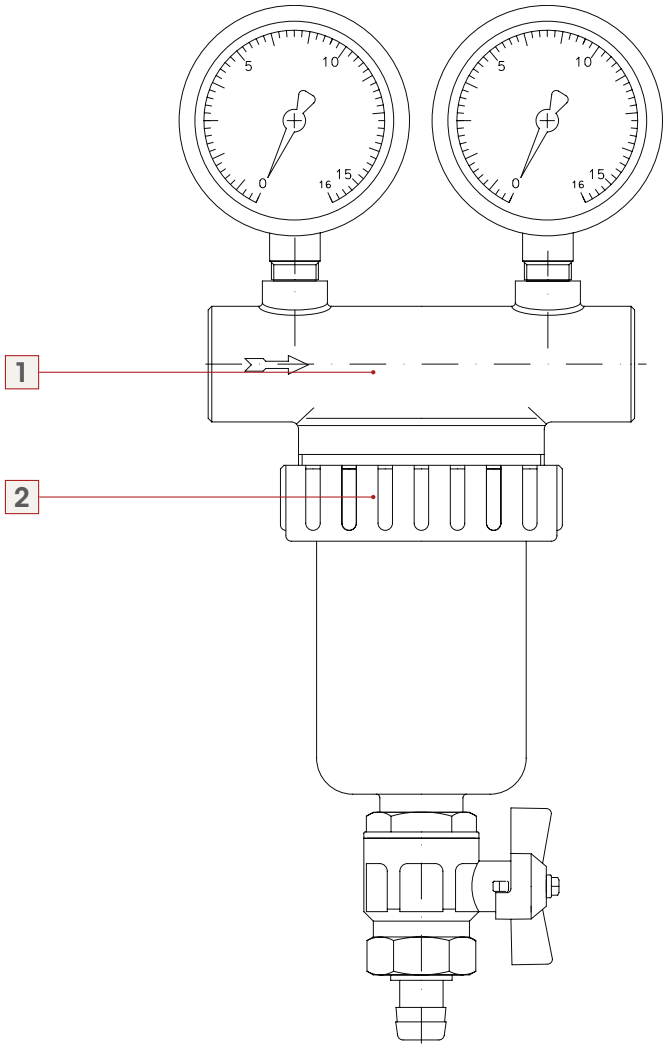


Pos.	DESCRIZIONE / *DESCRIPTION*	Qt.	MATERIALE / *MATERIAL*
1	Corpo / *Body*	-	Ottone nichelato / *Nickel-plated brass* CB735S EN 1984
2	Ghiera / *Nut*	-	Ottone nichelato / *Nickel-plated brass* CW617N
-	Cartuccia filtrante / *Cartridge*	-	Acciaio inox / *Stainless steel* AISI 304
-	Guarnizione di tenuta / *Cartridge seats*	-	NBR
-	O-Ring / *O-Ring*	-	NBR
-	Particolari in plastica / *Plastic parts*	-	Ultramid®

LOSS DIAGRAM

WITH WATER

Art: 189

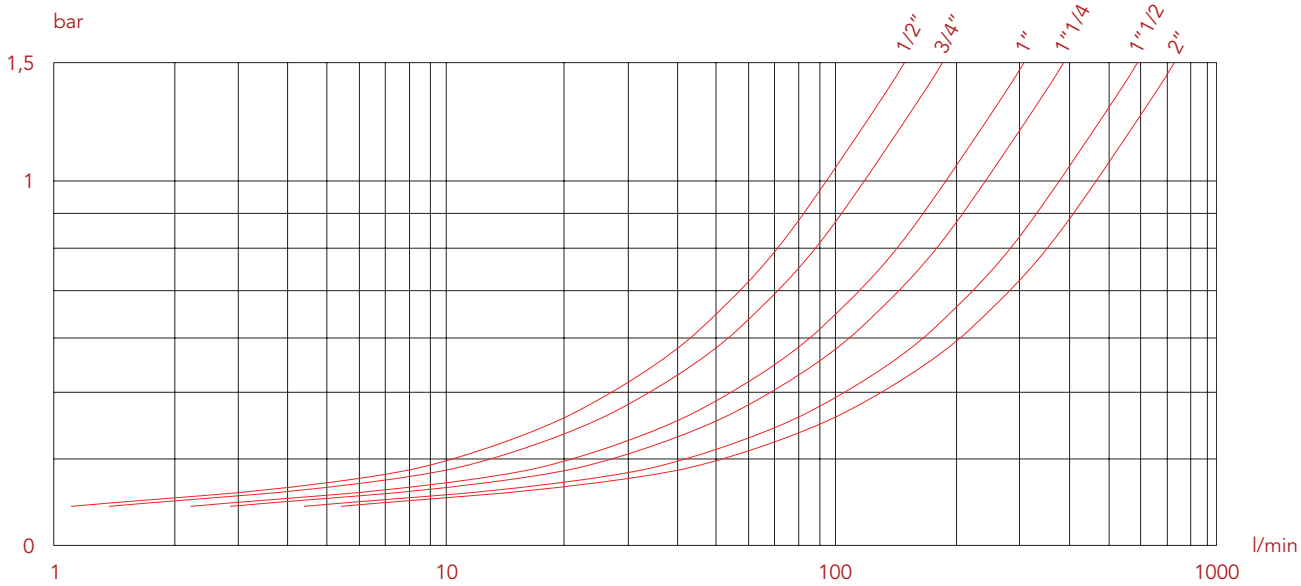

Subject to Change

DECLARATION OF CONFORMITY

(According to EN ISO/IEC 17050-1)

The ITAP S.p.A. manufacturer of valves, fittings, manifolds and accessories for thermo-sanitary plants, with head office in via Ruca 19/21 – 25065 Lumezzane S.S. (BS) Italy.

DECLARES

Under its sole responsibility that the Self-cleaning strainers have been built according to industry standards and conform to their technical specifications, respecting the Company Quality System complies with UNI EN ISO 9001.

Lumezzane 19 November 2013

Industrial Manager.

ITAP S.p.A.
IL CONSIGLIERE DELEGATO
EZIO PATTI

DECLARATION OF CONFORMITY

ITAP S.p.A. via Ruca 19/21 - 25065 Lumezzane S.S. (BS) Italy
Tel. 030 89270 - Fax. 030 8921990 - www.itap.it - sales@itap.it